City of Phoenix
WATER SERVICES DEPARTMENT
INDUSTRIAL WASTEWATER SURVEY

RETURN TO:
IPP.PlanReview@phoenix.gov
City of Phoenix
Water Services Department
Industrial Pretreatment Program
2474 South 22nd Avenue, Building 31
Phoenix, Arizona 85009

FOR CITY USE ONLY

☐ Permit Not Required
☐ Permit Application & Schematics Required for Further Evaluation

Business Name: _____

Business Address: _____

_____

Business Owner Name: _____

Phone Number: _____

Email: _____

Type of Business: ☐ Manufacturing ☐ Service ☐ Environmental Remediation ☐

Description of operation(s), product(s) service(s). (Attach a separate sheet if necessary)

_____

_____

Types, names of raw materials and chemicals used. (Attach a separate sheet if necessary)

Trade or Product Name	Raw Material or Chemical Component(s)	CAS #	Quantity Onsite

Is water used in manufacturing? Yes ☐ No ☐

Is wastewater discharged to sewer from manufacturing? Yes ☐ No ☐

Are any wastes processed or treated onsite? Yes ☐ No ☐

Are any wastes hauled offsite? Yes ☐ No ☐

If yes, please describe below. (Attach a separate sheet if necessary)

_____

_____

Water Account Numbers: _____

Please attach either a water balance diagram (see attached example) or a water balance table to this survey showing:

(a) Incoming water sources and volumes
(b) How these sources of water are distributed and used throughout the facility
(c) Water losses with volumes throughout the facility
(d) Outgoing water, wastes, and wastewater with volumes (include wastes that are hauled off site).

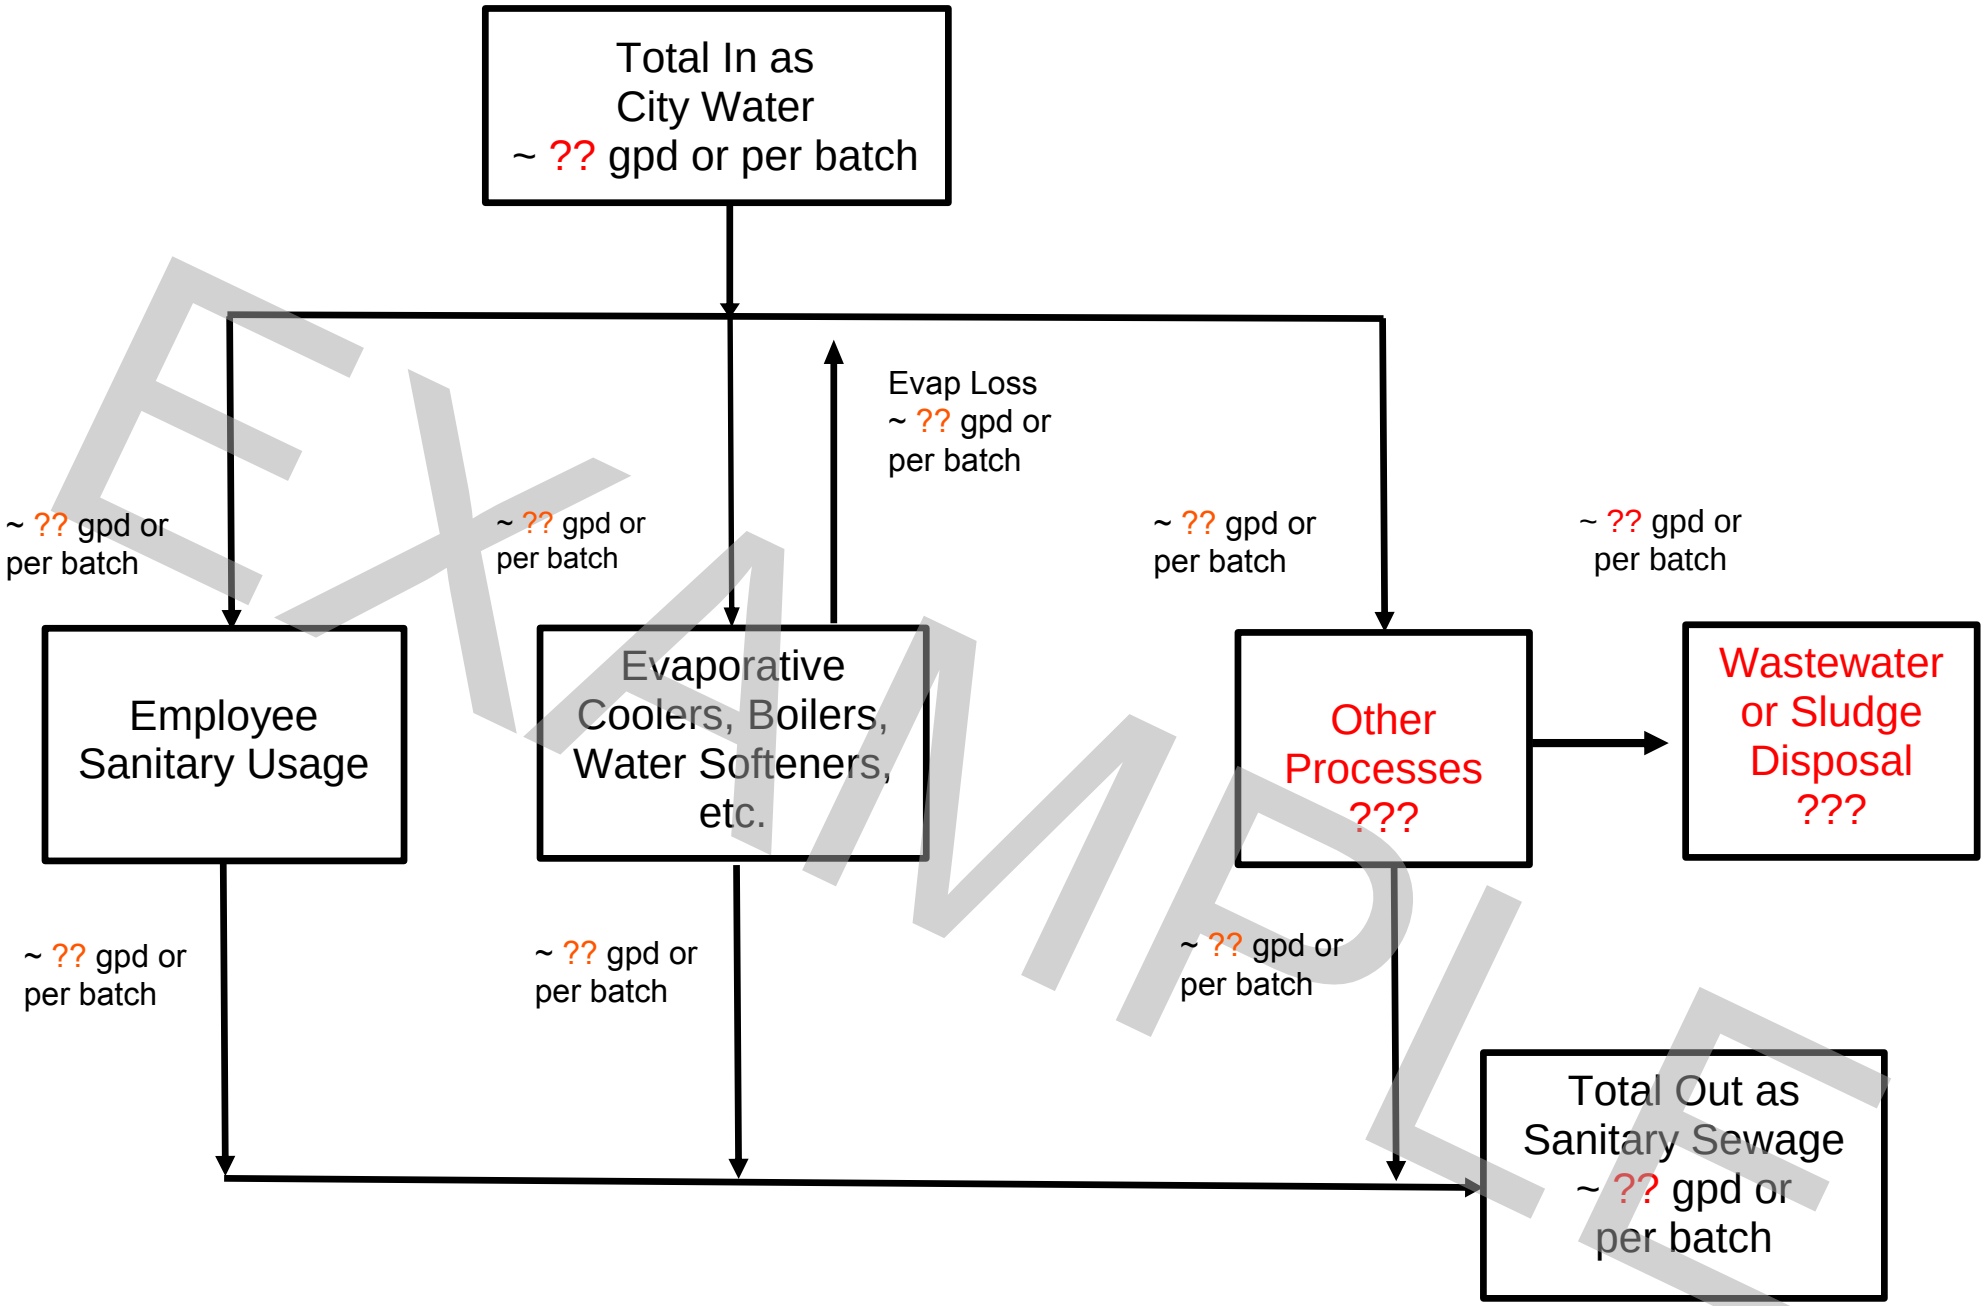
Total In as
City Water
~ ?? gpd or per batch
Evap Loss
~ ?? gpd or
per batch
~ ?? gpd or
per batch
~ ?? gpd or
per batch
~ ?? gpd or
per batch
~ ?? gpd or
per batch
Employee
Sanitary Usage
Evaporative
Coolers, Boilers,
Water Softeners,
etc.
Other
Processes
???
Wastewater
or Sludge
Disposal
???
~ ?? gpd or
per batch
~ ?? gpd or
per batch
~ ?? gpd or
per batch
Total Out as
Sanitary Sewage
~ ?? gpd or
per batch

EXAMPLE