


ATTIC VENTILATION

SQ FT / 300 OR 150 = SQ FT
OF VENTING REQUIRED. [IRC R806]

WOOD TRUSSES SHALL BE PROVIDED BY AN APPROVED TRUSS FABRICATOR. PROVIDE TRUSS DIAGRAMS AND DATA TO CITY INSPECTOR AT FRAMING INSPECTION. [IRC R802.10]

PROJECT ADDRESS:

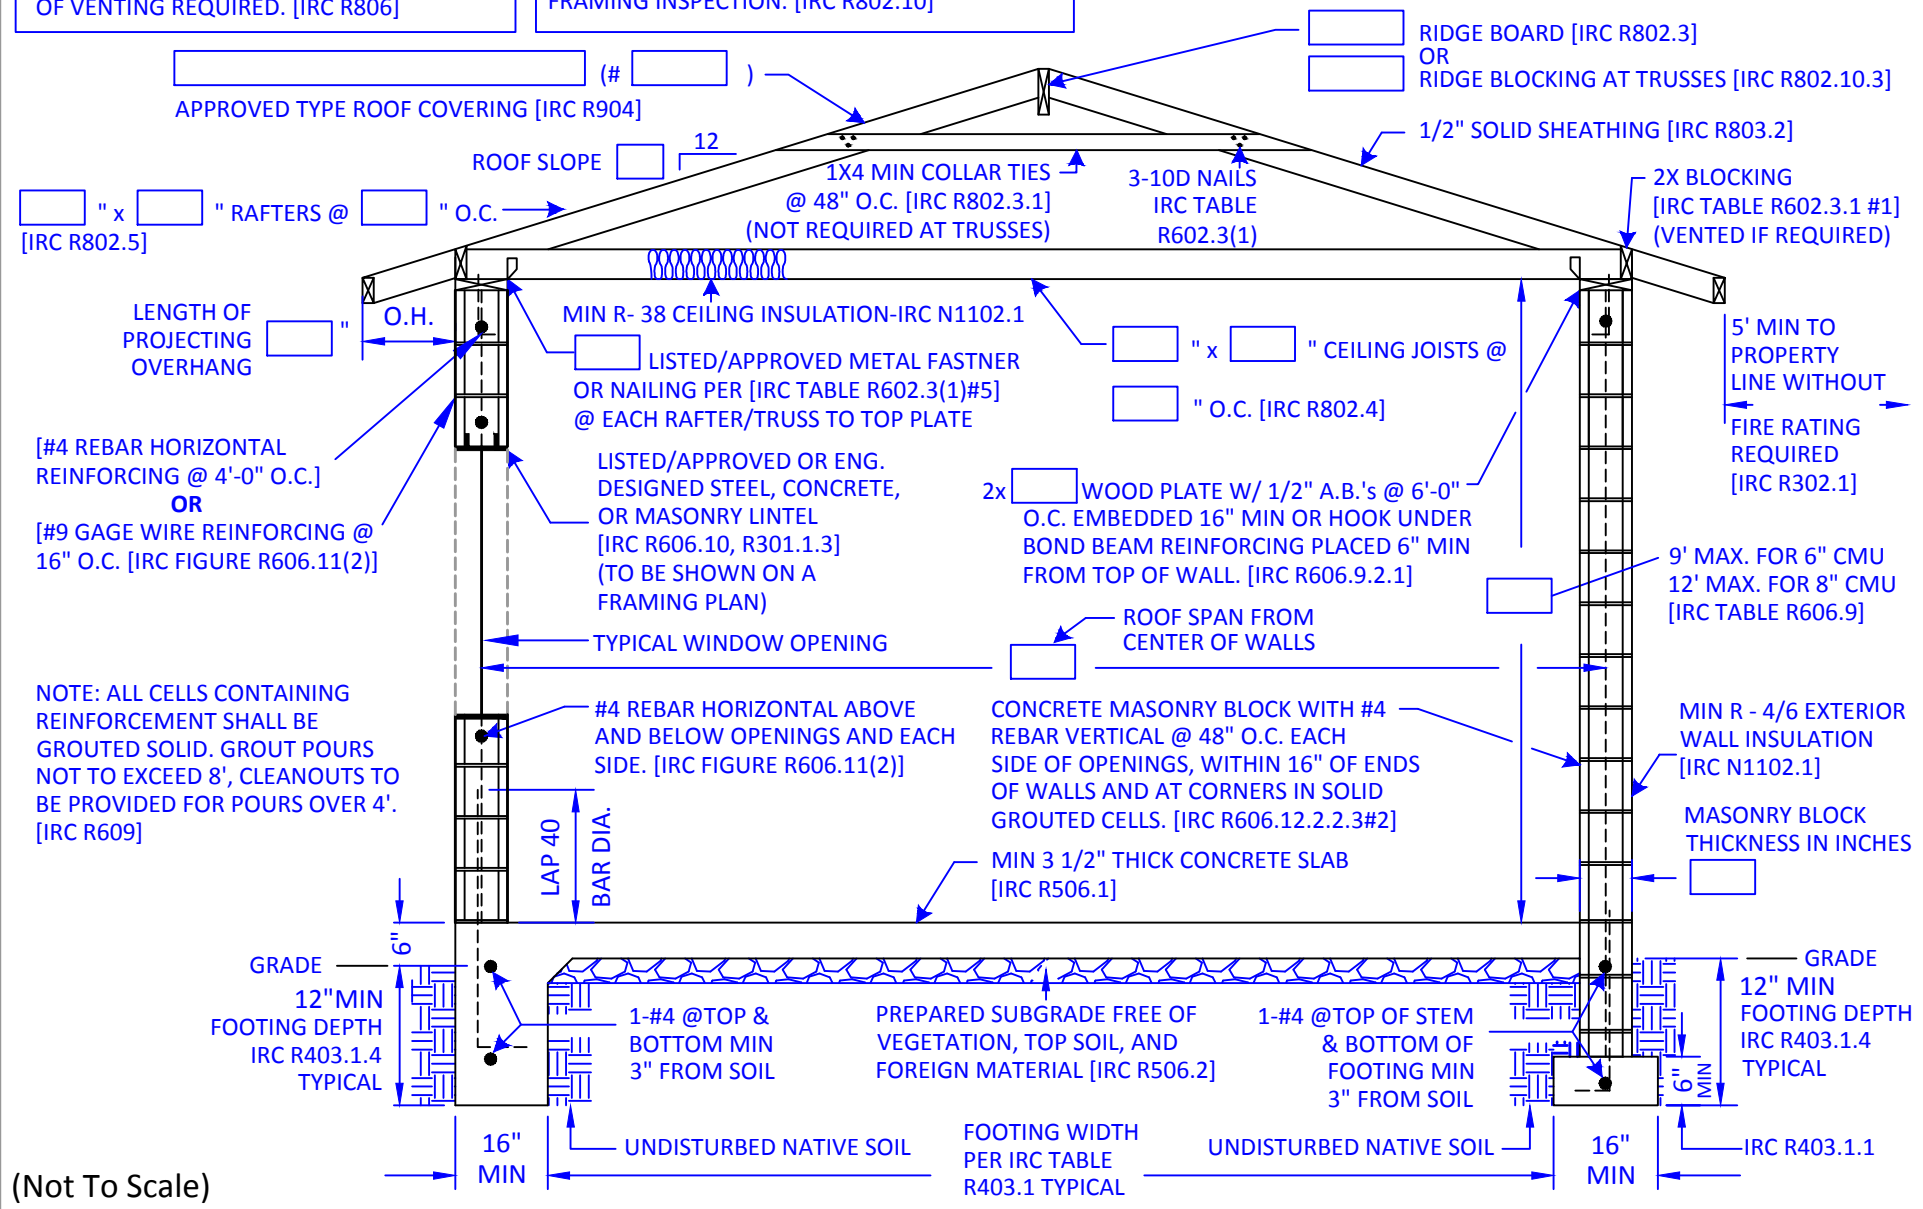

NOTE: ALL CELLS CONTAINING REINFORCEMENT SHALL BE GROUTED SOLID. GROUT POURS NOT TO EXCEED 8', CLEANOUTS TO BE PROVIDED FOR POURS OVER 4'. [IRC R609]

(Not To Scale)